


APT 24

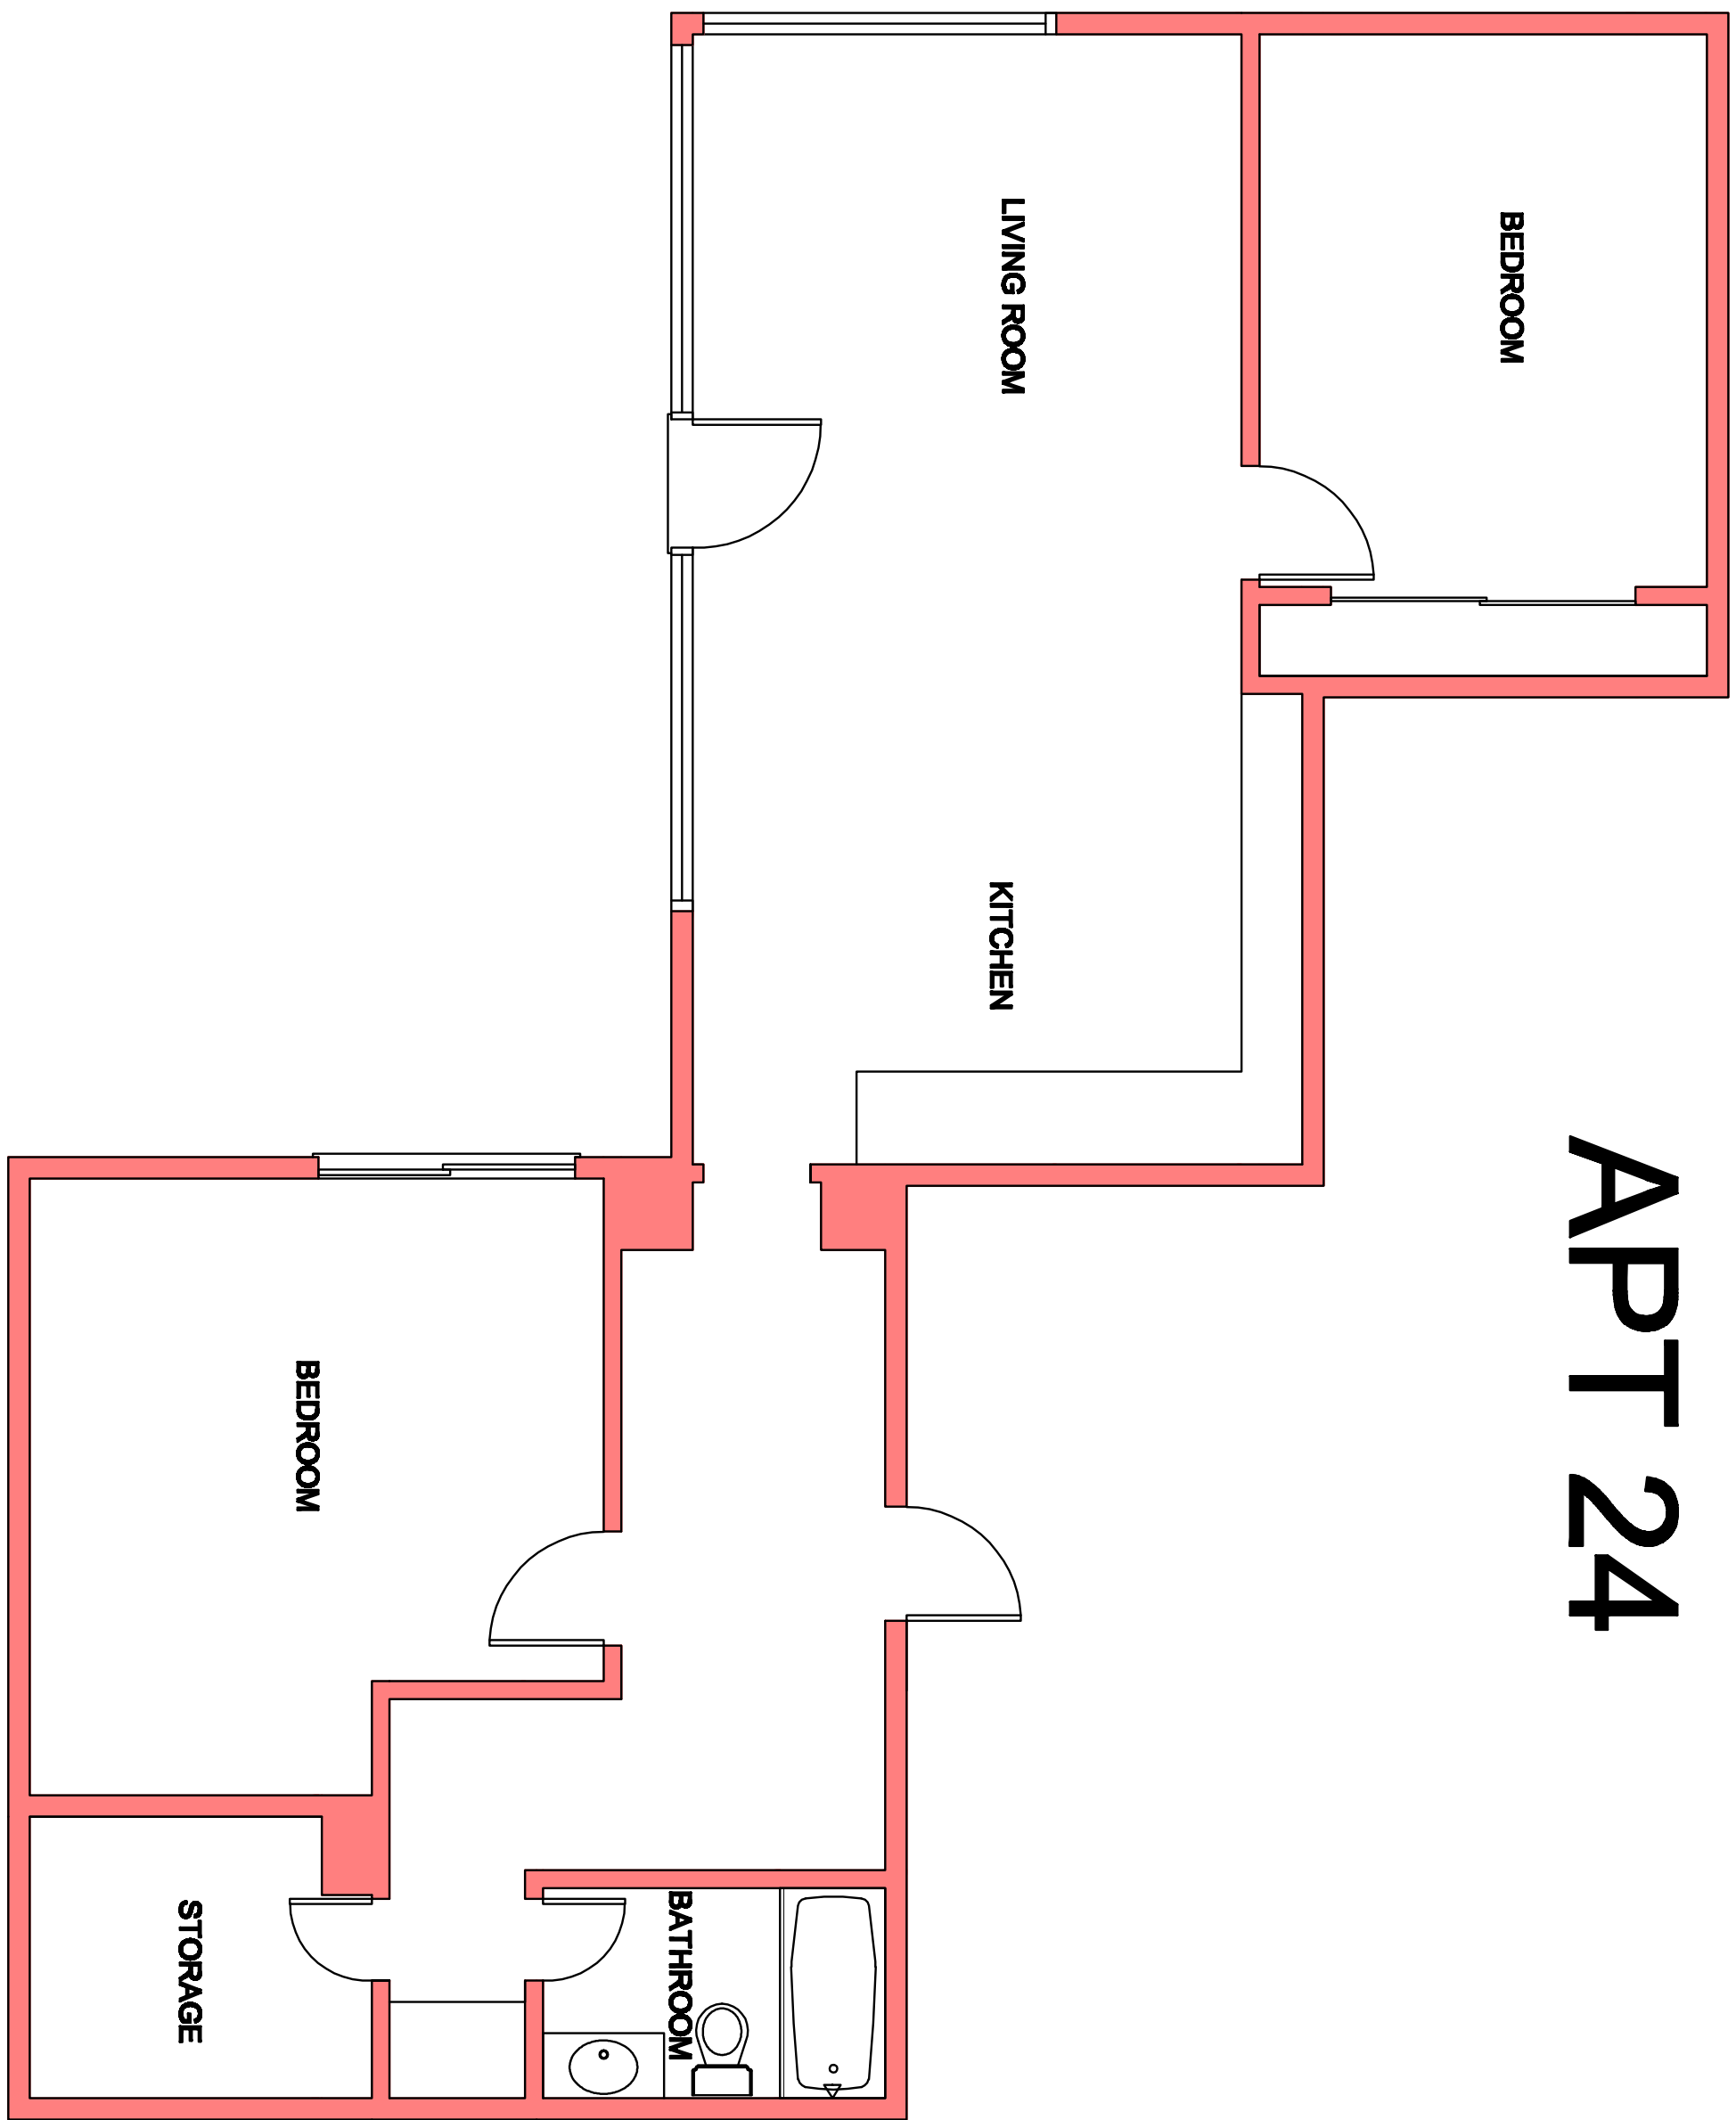

⑧ HARDWIRED SMOKE DETECTOR W/ LOW BATTERY SIGNAL/NOTE. ALL SMOKE DETECTORS SHALL BE 120VOLT STATE FIRE MARSHALL APPROVED DEVICES INSTALLED IN ACCORDANCE WITH THEIR LISTING AND WITH A BATTERY BACKUP)

⑨ EXISTING WALLS TO REMAIN


⑩ NEW WALLS (2x4 STUDS @ 16" O.C.)

⑪ NEW MASONRY

⑫ NEW WALLS (2x6 STUDS @ 16" O.C.)

EXISTING FIRST FLOOR PLAN SCALE 1/4" = 1'-0" A

3A

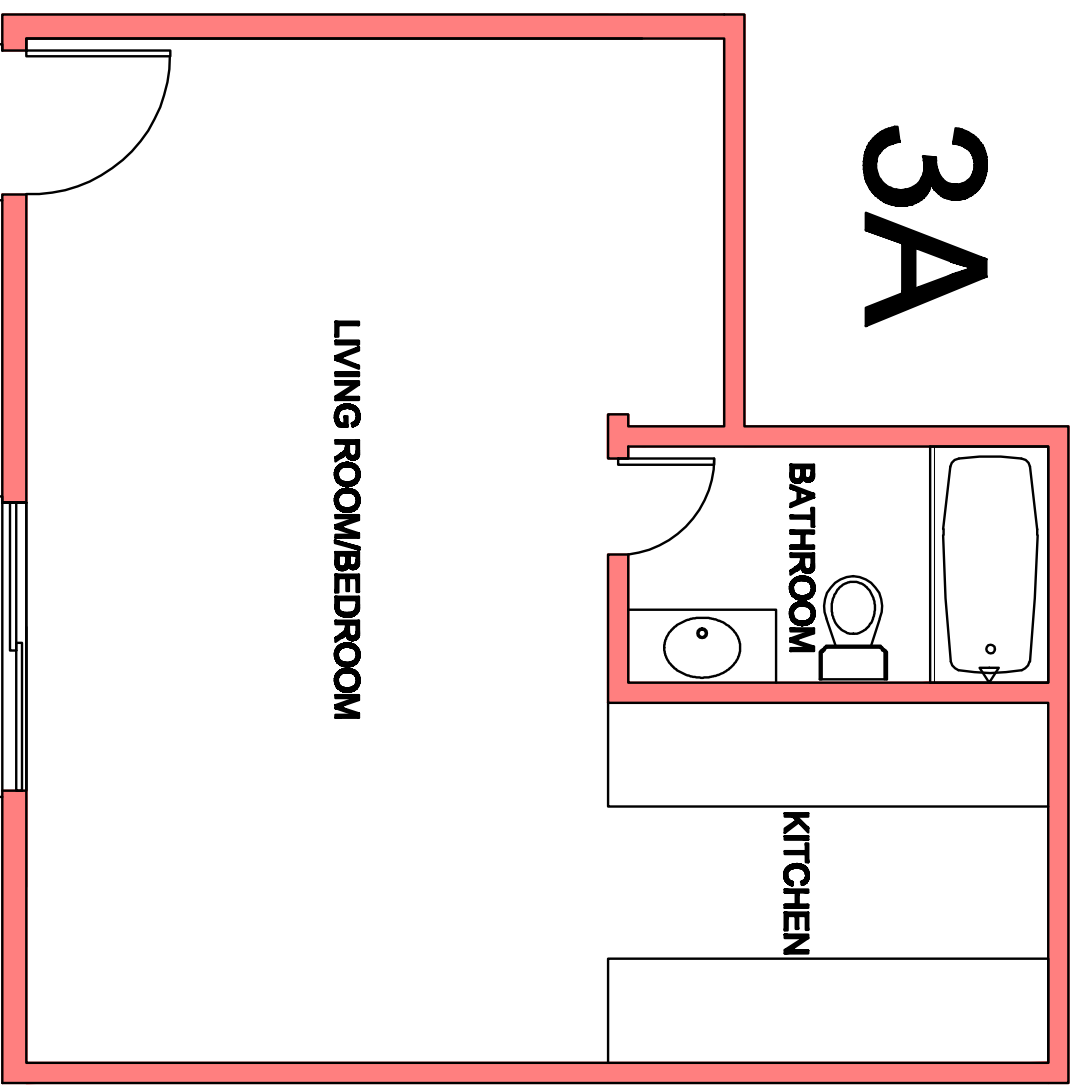

⑧ HARDWIRED SMOKE DETECTOR W/ LOW BATTERY SIGNAL/NOTE. ALL SMOKE DETECTORS SHALL BE 120VOLT STATE FIRE MARSHALL APPROVED DEVICES INSTALLED IN ACCORDANCE WITH THEIR LISTING AND WITH A BATTERY BACKUP)

⑨ EXISTING WALLS TO REMAIN


⑩ NEW WALLS (2x4 STUDS @ 16" O.C.)

⑪ NEW MASONRY

⑫ NEW WALLS (2x6 STUDS @ 16" O.C.)

EXISTING FIRST FLOOR PLAN SCALE 1/4" = 1'-0" C

6A

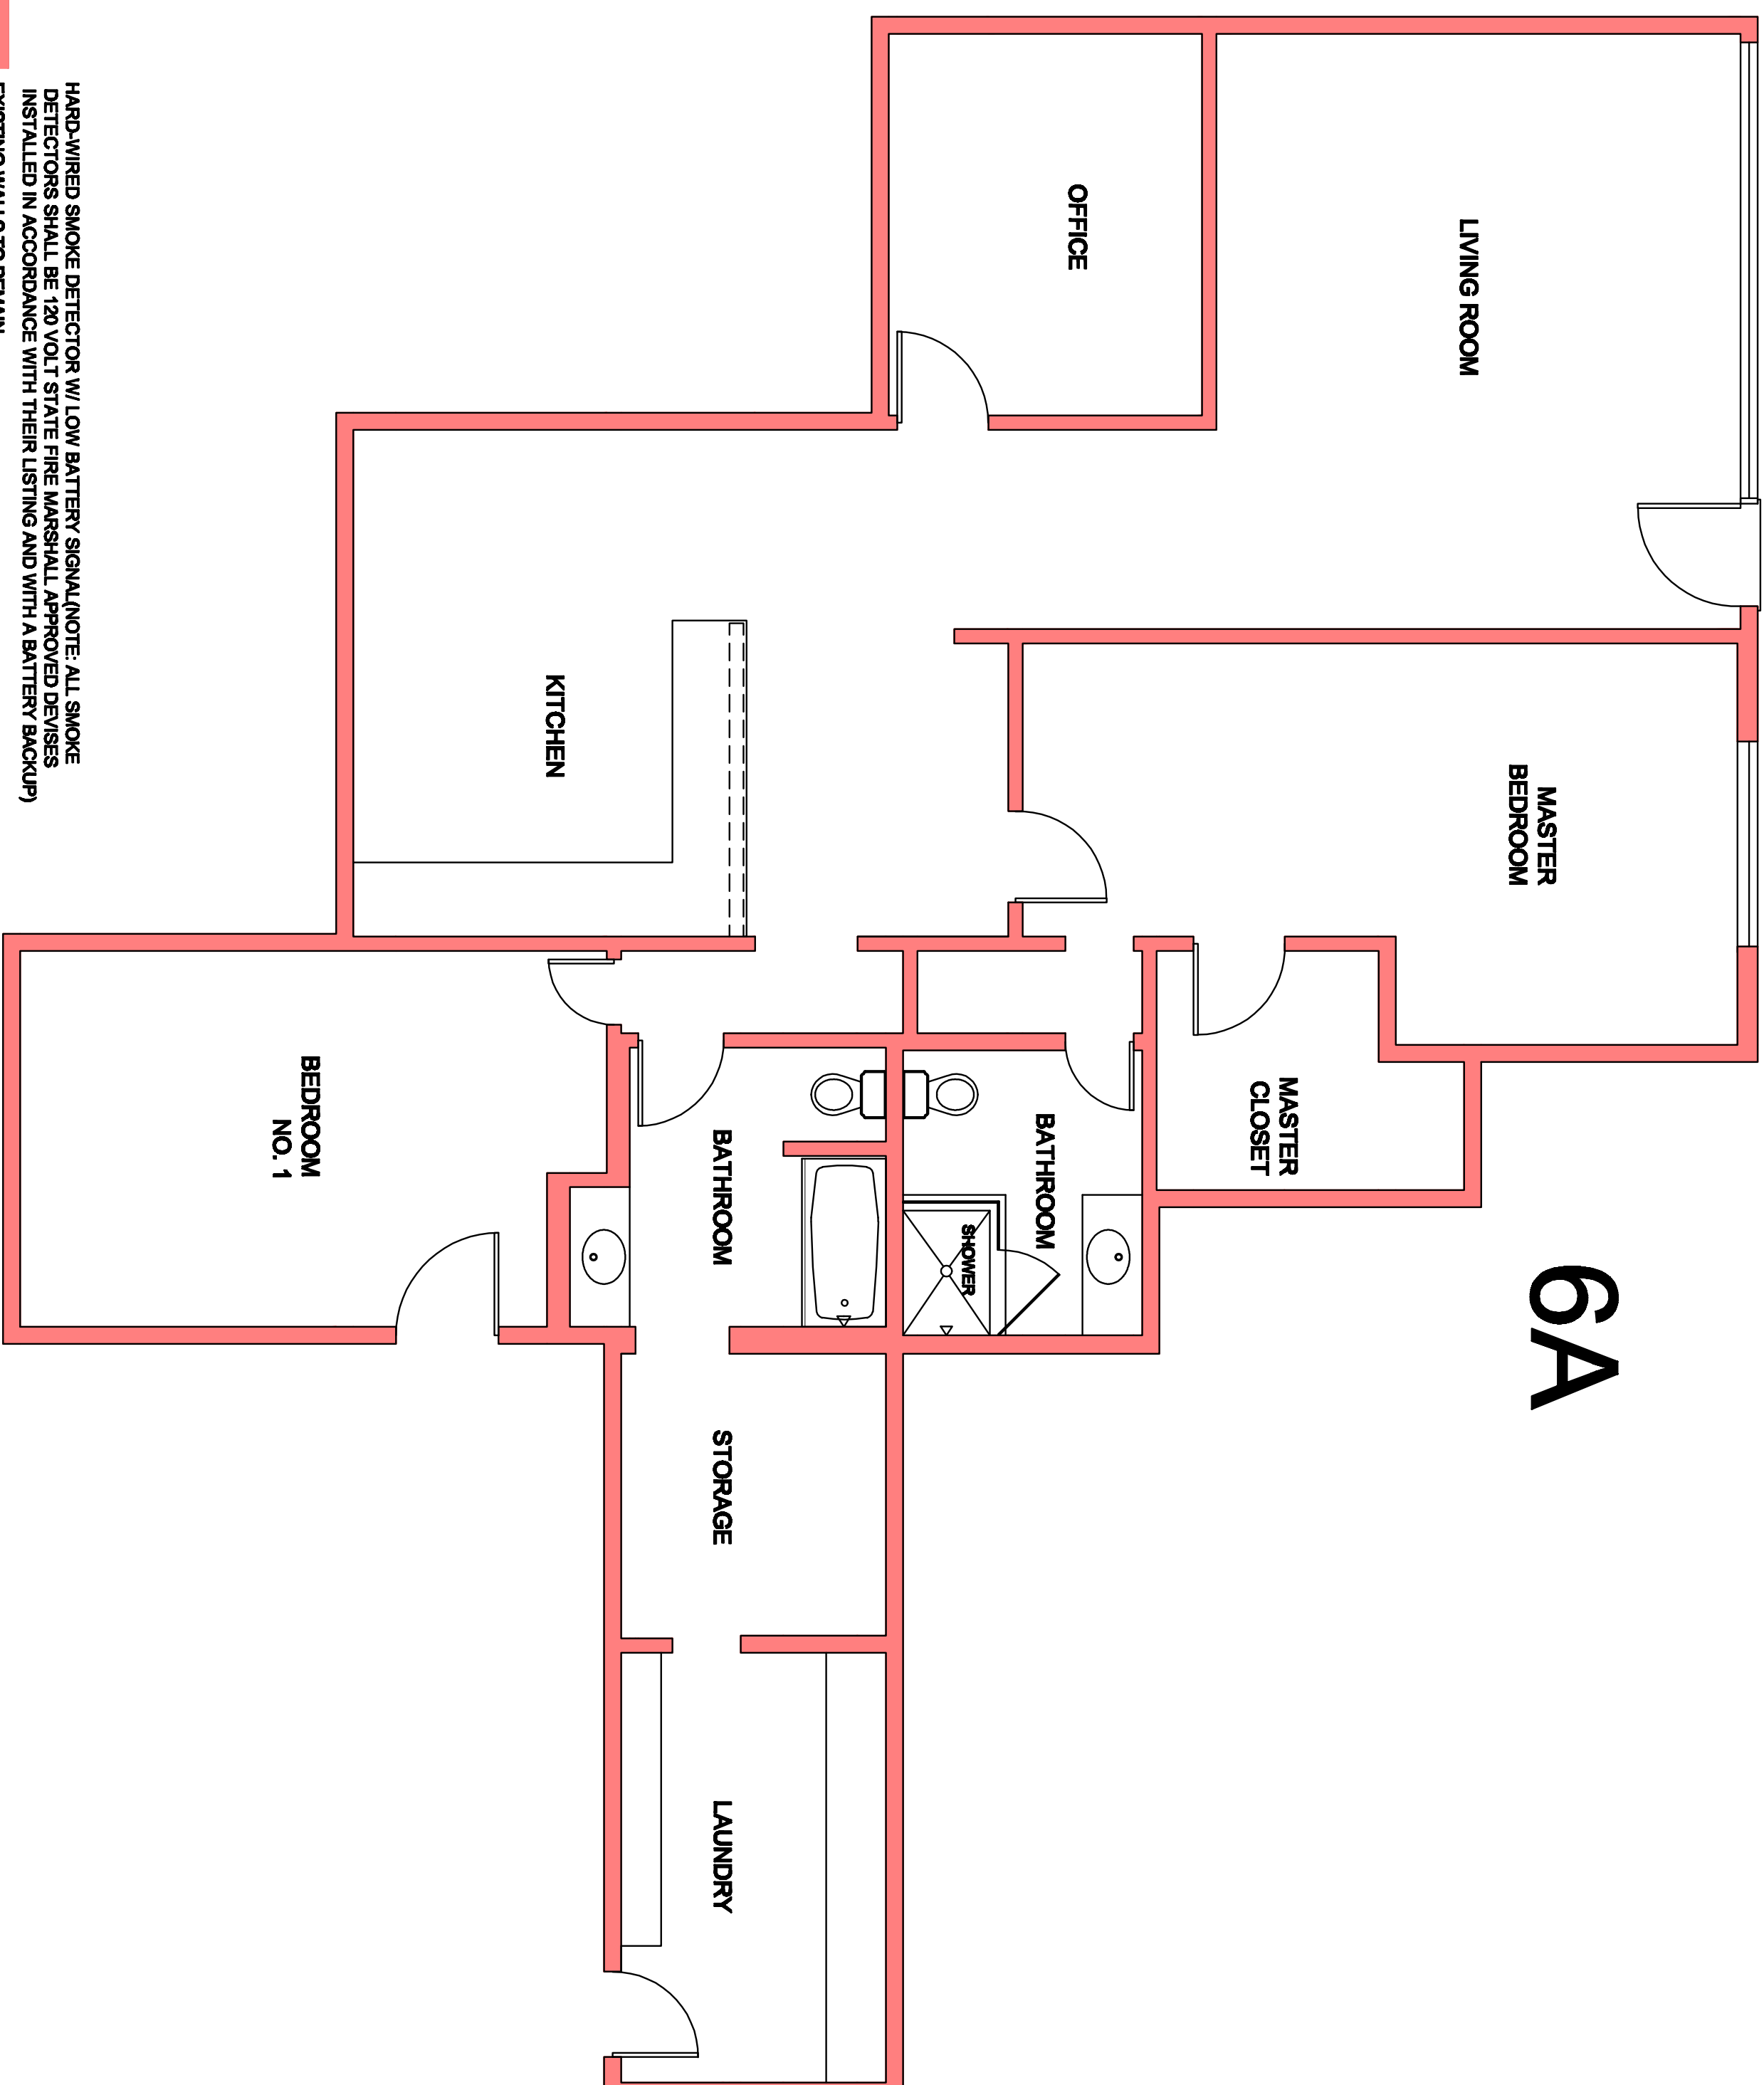

⑧ HARDWIRED SMOKE DETECTOR W/ LOW BATTERY SIGNAL/NOTE. ALL SMOKE DETECTORS SHALL BE 120VOLT STATE FIRE MARSHALL APPROVED DEVICES INSTALLED IN ACCORDANCE WITH THEIR LISTING AND WITH A BATTERY BACKUP)


⑨ EXISTING WALLS TO REMAIN

⑩ NEW WALLS (2x4 STUDS @ 16" O.C.)

⑪ NEW MASONRY

⑫ NEW WALLS (2x6 STUDS @ 16" O.C.)

EXISTING FIRST FLOOR PLAN SCALE 1/4" = 1'-0" B

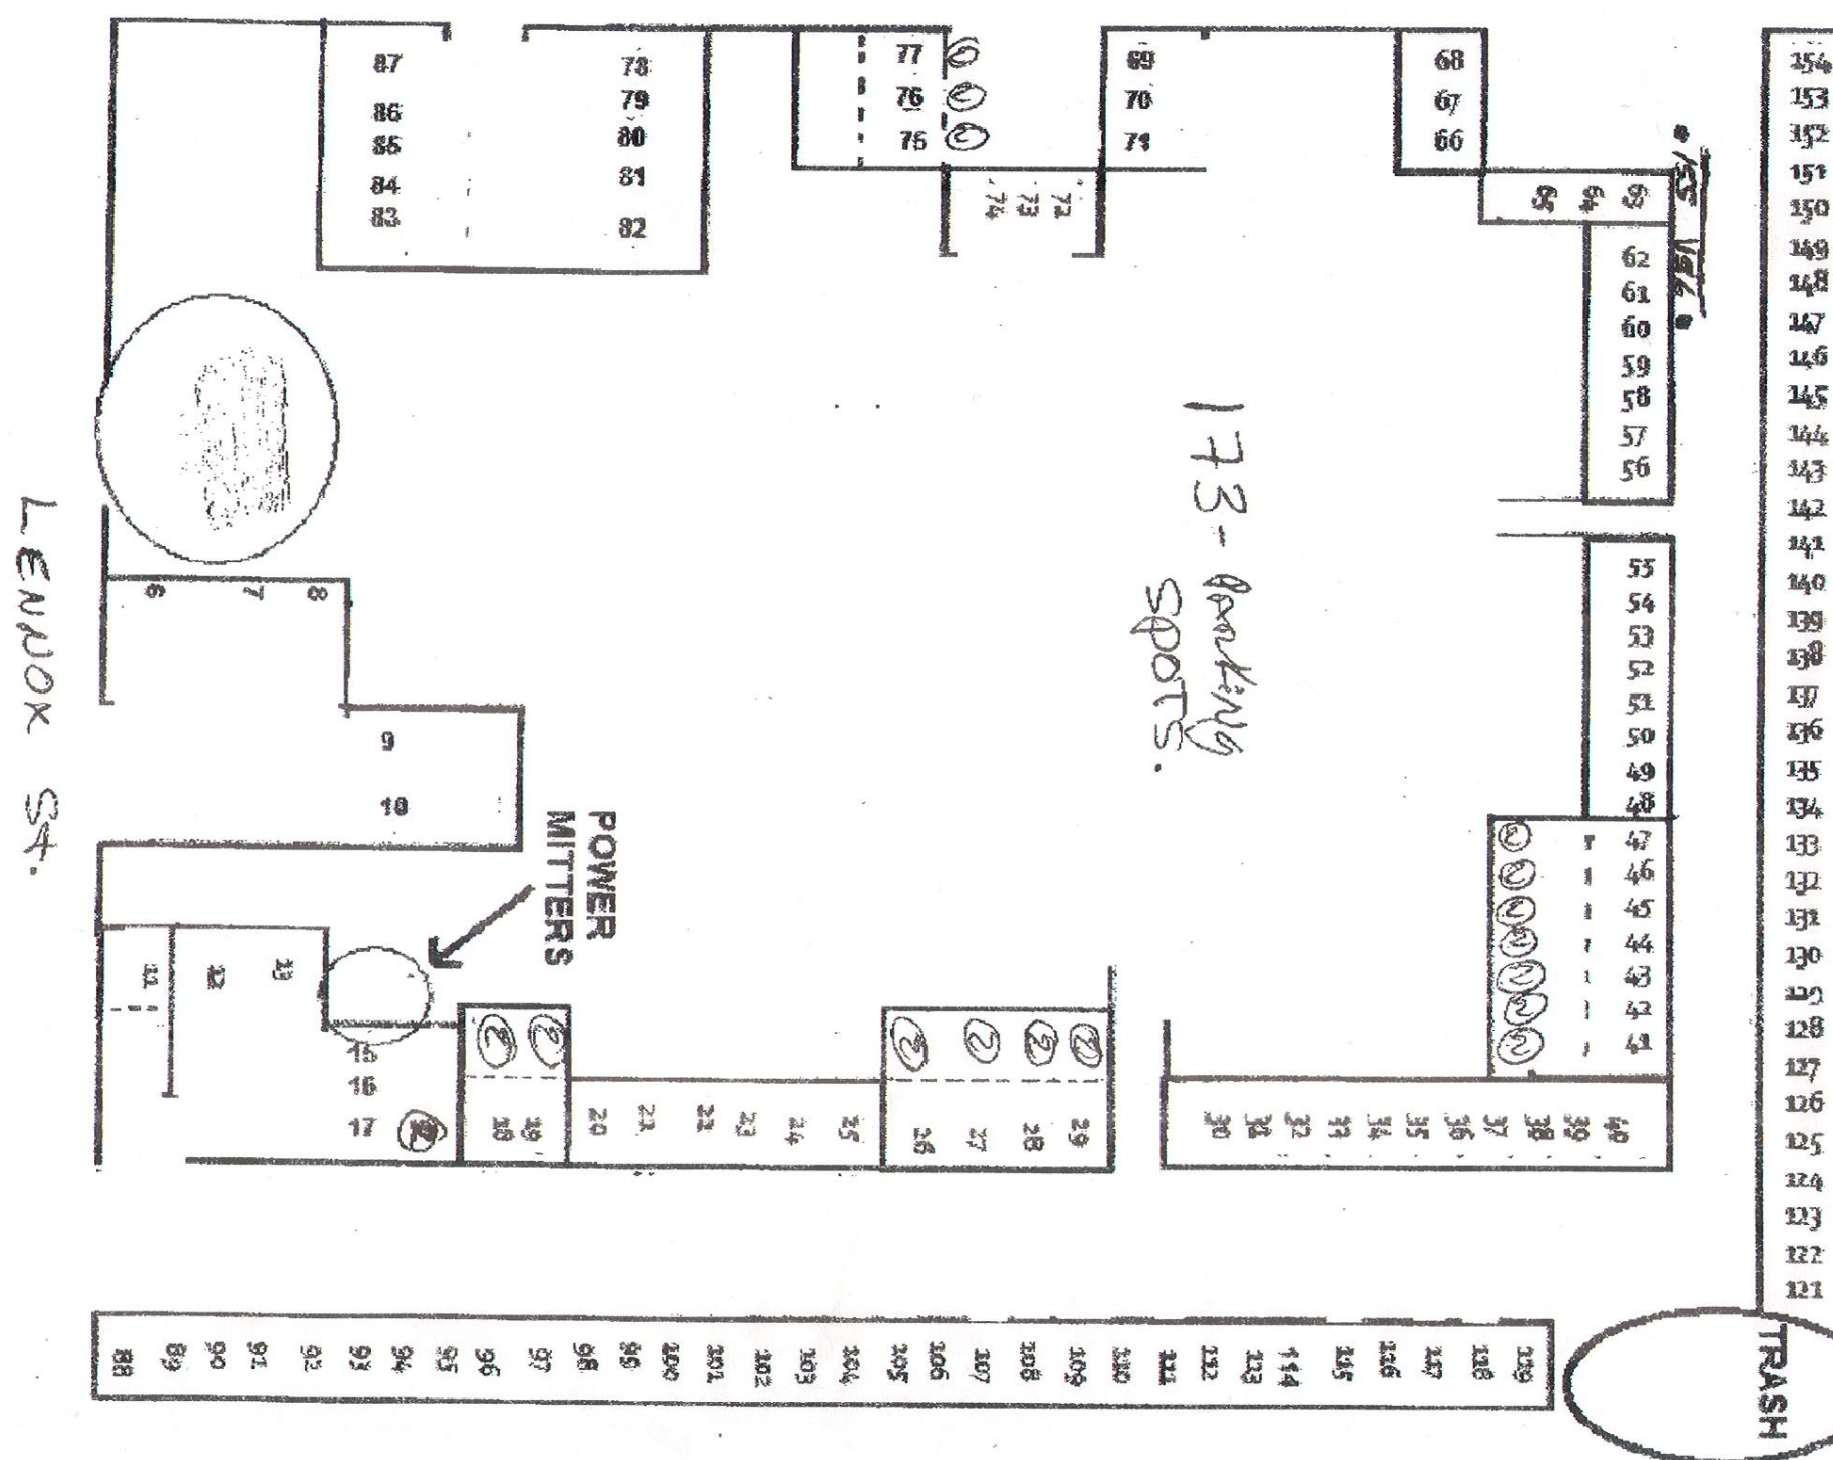

REVISIONS	BY	DATE

DATE: 12/07/2014
SHEET NUMBER: **A-3.01**
TITLE SHEET